NOTES THIS SHEET

1. PROVIDE SHUT-OFF VARIABLE AIR VOLUME UNIT WITH HOT WATER REHEAT COIL. MAINTAIN MANUFACTURER'S RECOMMENDED CLEARANCE AROUND UNIT AS INDICATED. REFER TO VAV SCHEDULE ON DRAWING M5.1W. PROVIDE HANGERS AND SUPPORTS COMPLETE. SUSPEND FROM OVERHEAD STRUCTURE WITH VIBRATION ISOLATION HANGERS. PROVIDE INTERMEDIATE STEEL ANGLE SUPPORTS AS REQUIRED. PROVIDE BACNET COMPATIBLE VAV CONTROLLER.
2. PROVIDE DOUBLE WALL, SPIRAL WOUND INTERSTITIALLY LINED MEDIUM PRESSURE DUCTWORK, INSULATION, HANGERS, AND SUPPORTS COMPLETE UPSTREAM OF VAV BOX.
3. PROVIDE LOW PRESSURE DUCTWORK, INSULATION, HANGERS, AND SUPPORTS COMPLETE.
4. PROVIDE EXHAUST RETURN DUCTWORK, HANGERS, AND SUPPORTS. SIZE AS INDICATED ON DRAWING.
5. PROVIDE CEILING MOUNTED UNIT HEATER, HANGERS, AND SUPPORTS.
6. PROVIDE 8x8 ACCESS DOOR.

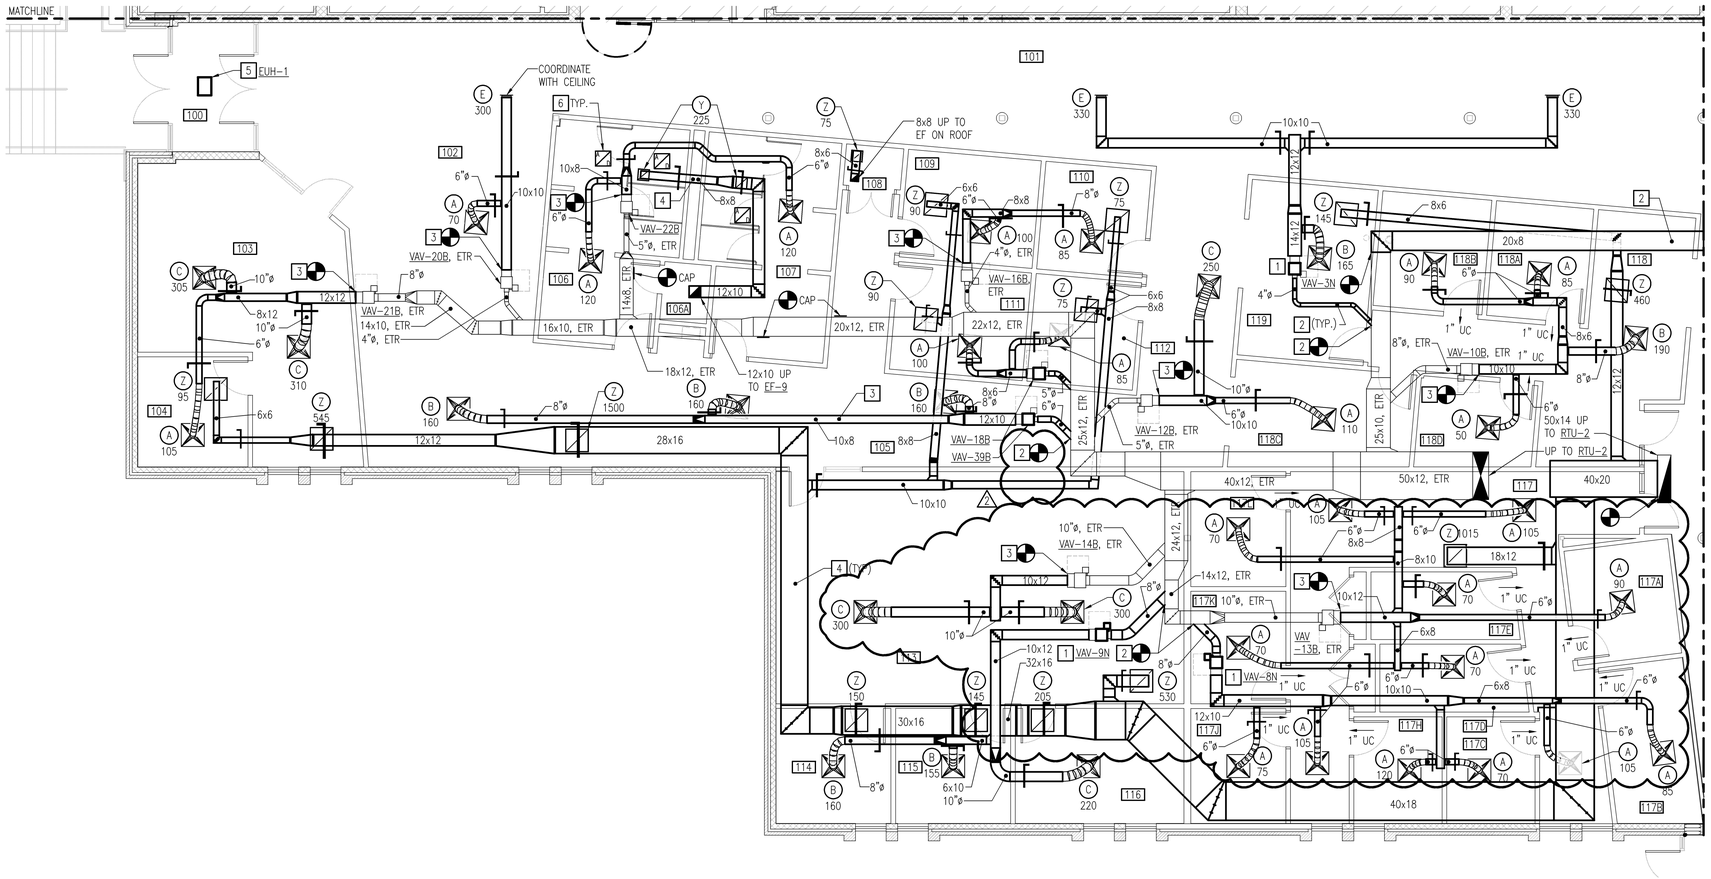

NEW WORK FLOOR PLAN - MECHANICAL DUCTWORK

SCALE: 3/16" = 1'-0"

SECTION 2 ROOM SCHEDULE

100	VESTIBULE
101	CORRIDOR
102	RECEPTION
103	ADMISSIONS
104	OFFICE
105	CORRIDOR
106	MENS
106A	JANITOR
107	WOMENS
108	CLOSET
109	OFFICE
110	OFFICE
111	OFFICE
112	OFFICE
113	OPEN OFFICE
114	OFFICE
115	OFFICE
116	OFFICE
117	OPEN OFFICE
117A	HUDDLE
118	OFFICE
118A	OFFICE
118B	OFFICE
118C	PURCHASING
118D	STORAGE
119	CASHIER



KEYPLAN

NO SCALE

GRAPHIC SCALES

3/16" = 1'-0" 0' 5' 10' 20'

nbj ARCHITECTURE
A Professional Limited Company
GROVE PARK SQUARE
11537-B NUCKOLS ROAD
Richmond, Virginia 23059
(804) 273-9811 fax: (804) 273-9843

RAPPAHANNOCK COMMUNITY COLLEGE
CAMPUS RENOVATIONS
WARSAW + GLENNS, VIRGINIA
PC: 260-17712

WARSAW CAMPUS NEW WORK FLOOR PLAN - MECHANICAL DUCTWORK

Date: MARCH 3, 2010

REVISIONS

NO.	DATE
1	FEBRUARY 9, 2010
2	MARCH 3, 2010

PACE COLLABORATIVE
MECHANICAL ELECTRICAL ENGINEERS
VIRGINIA BEACH, VA - 757-490-7229

COMMONWEALTH OF VIRGINIA
JOHN M. NEWELL
Lic. No. 035329
PROFESSIONAL ENGINEER

Sheet
M1.2W

File Number
XX